


GAPDH 1° 1:50K CTH validation for Joe
2° Ab anti-rabbit 1:2000 for 3h

5/4/22

ACZ

KD line 2 KD line 2 KD line 2
sample 1 sample 2 sample 3

Control Control Control
1 2 3

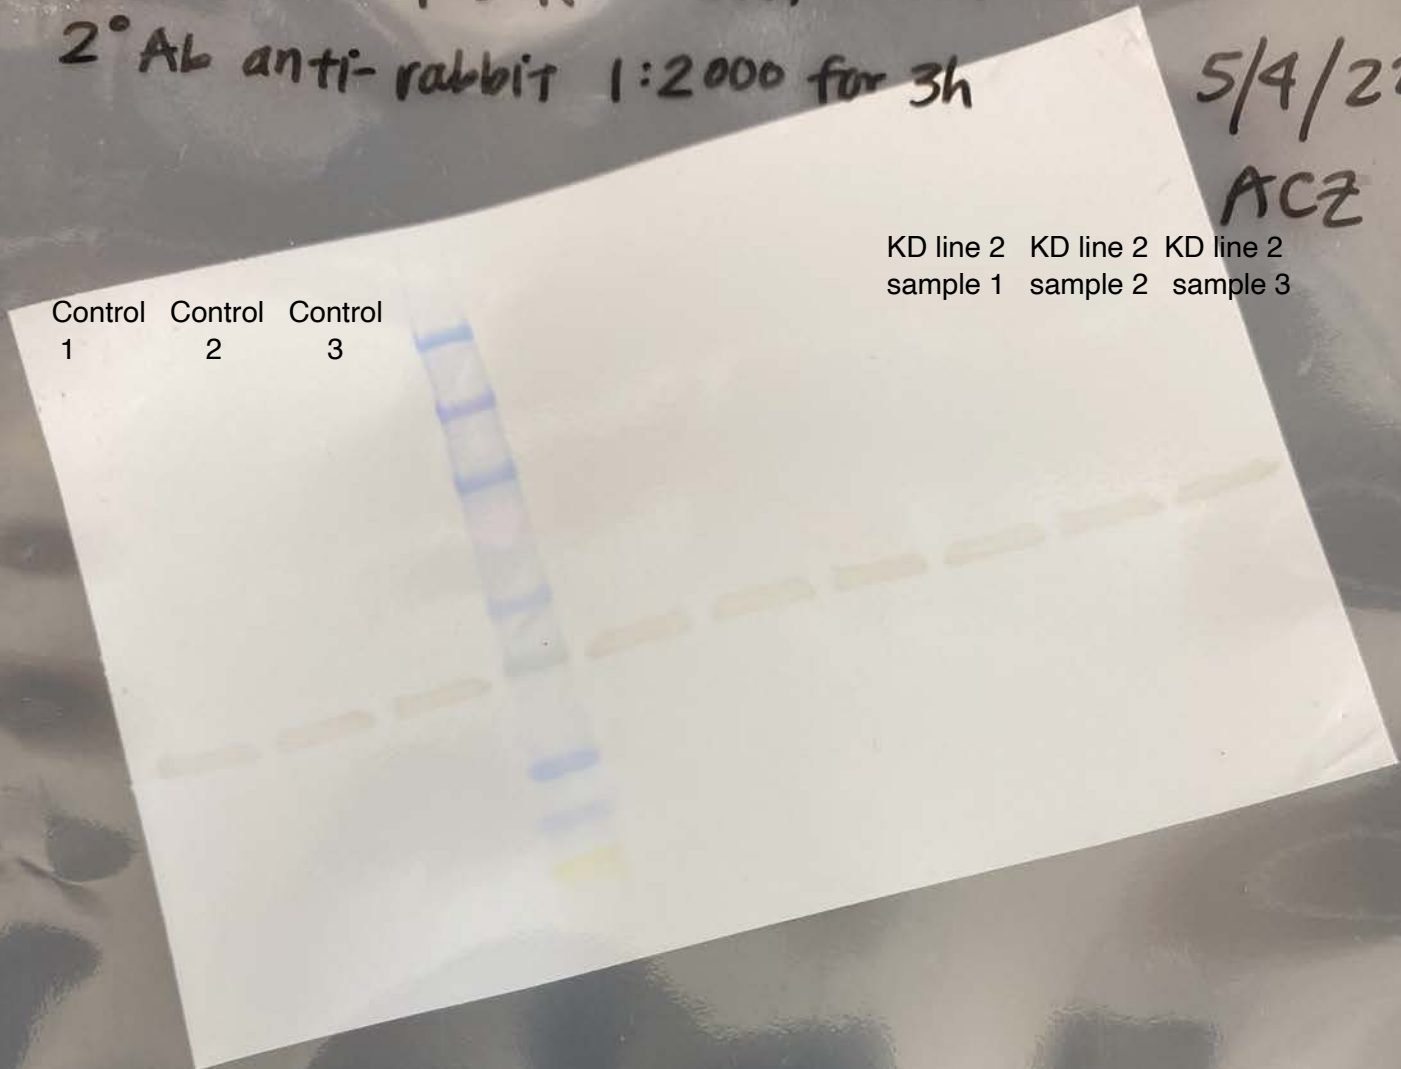

CTH validation

CTH blot


1° 1:1000

2°

Control Control Control
Sample 1 Sample 2 Sample 3

KD line 1 KD line 1 KD line 1
sample 1 sample 2 sample 3

KD line 2 KD line 2 KD line 2
sample 1 sample 2 sample 3

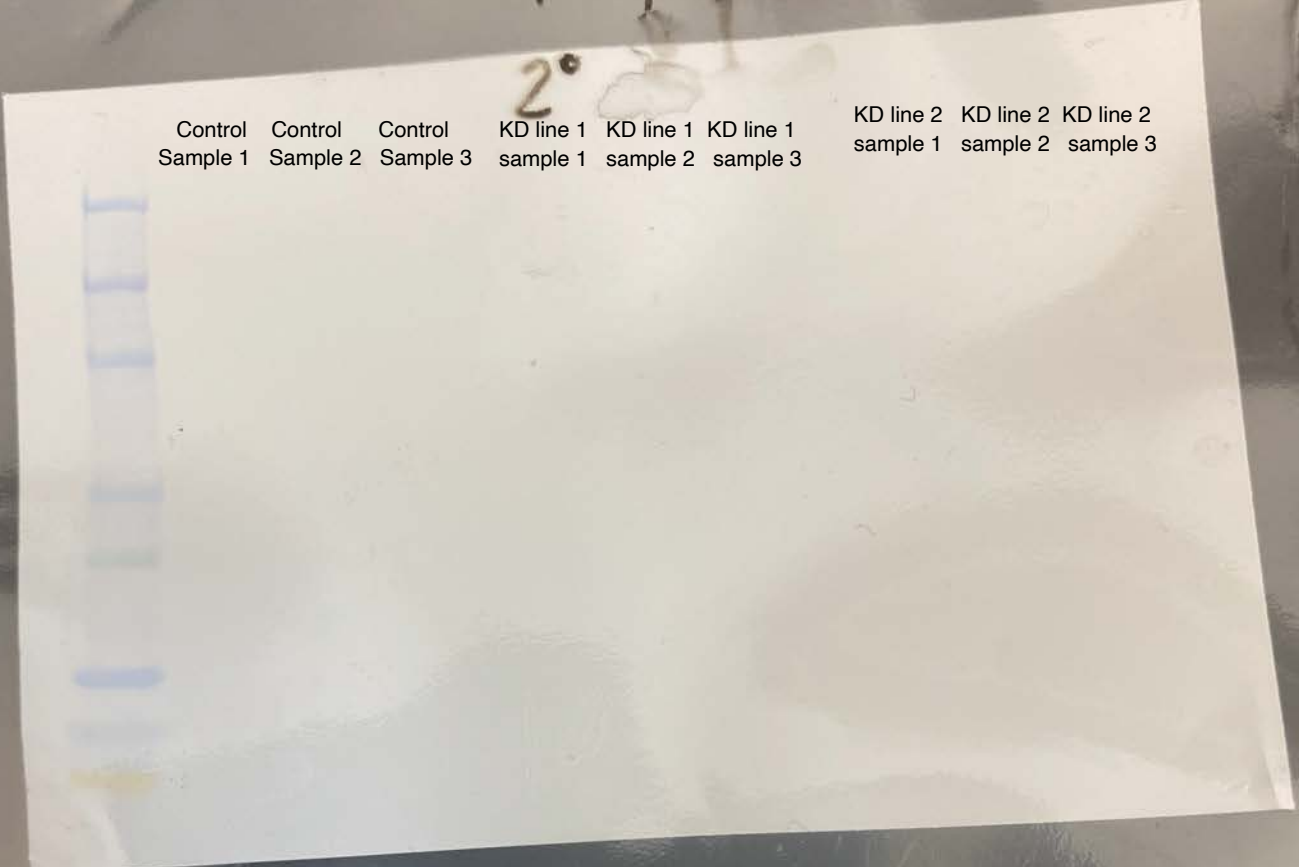

anti-rabbit

2° 1:2000 for 3h

5/6/22 ACZ

Control Sample 1 Control Sample 2 Control Sample 3 KD Line 1 Sample 1 KD Line 1 Sample 2 KD Line 1 Sample 3 KD Line 2 Sample 1 KD Line 2 Sample 2 KD Line 2 Sample 3

