


True positive rate (sensitivity)

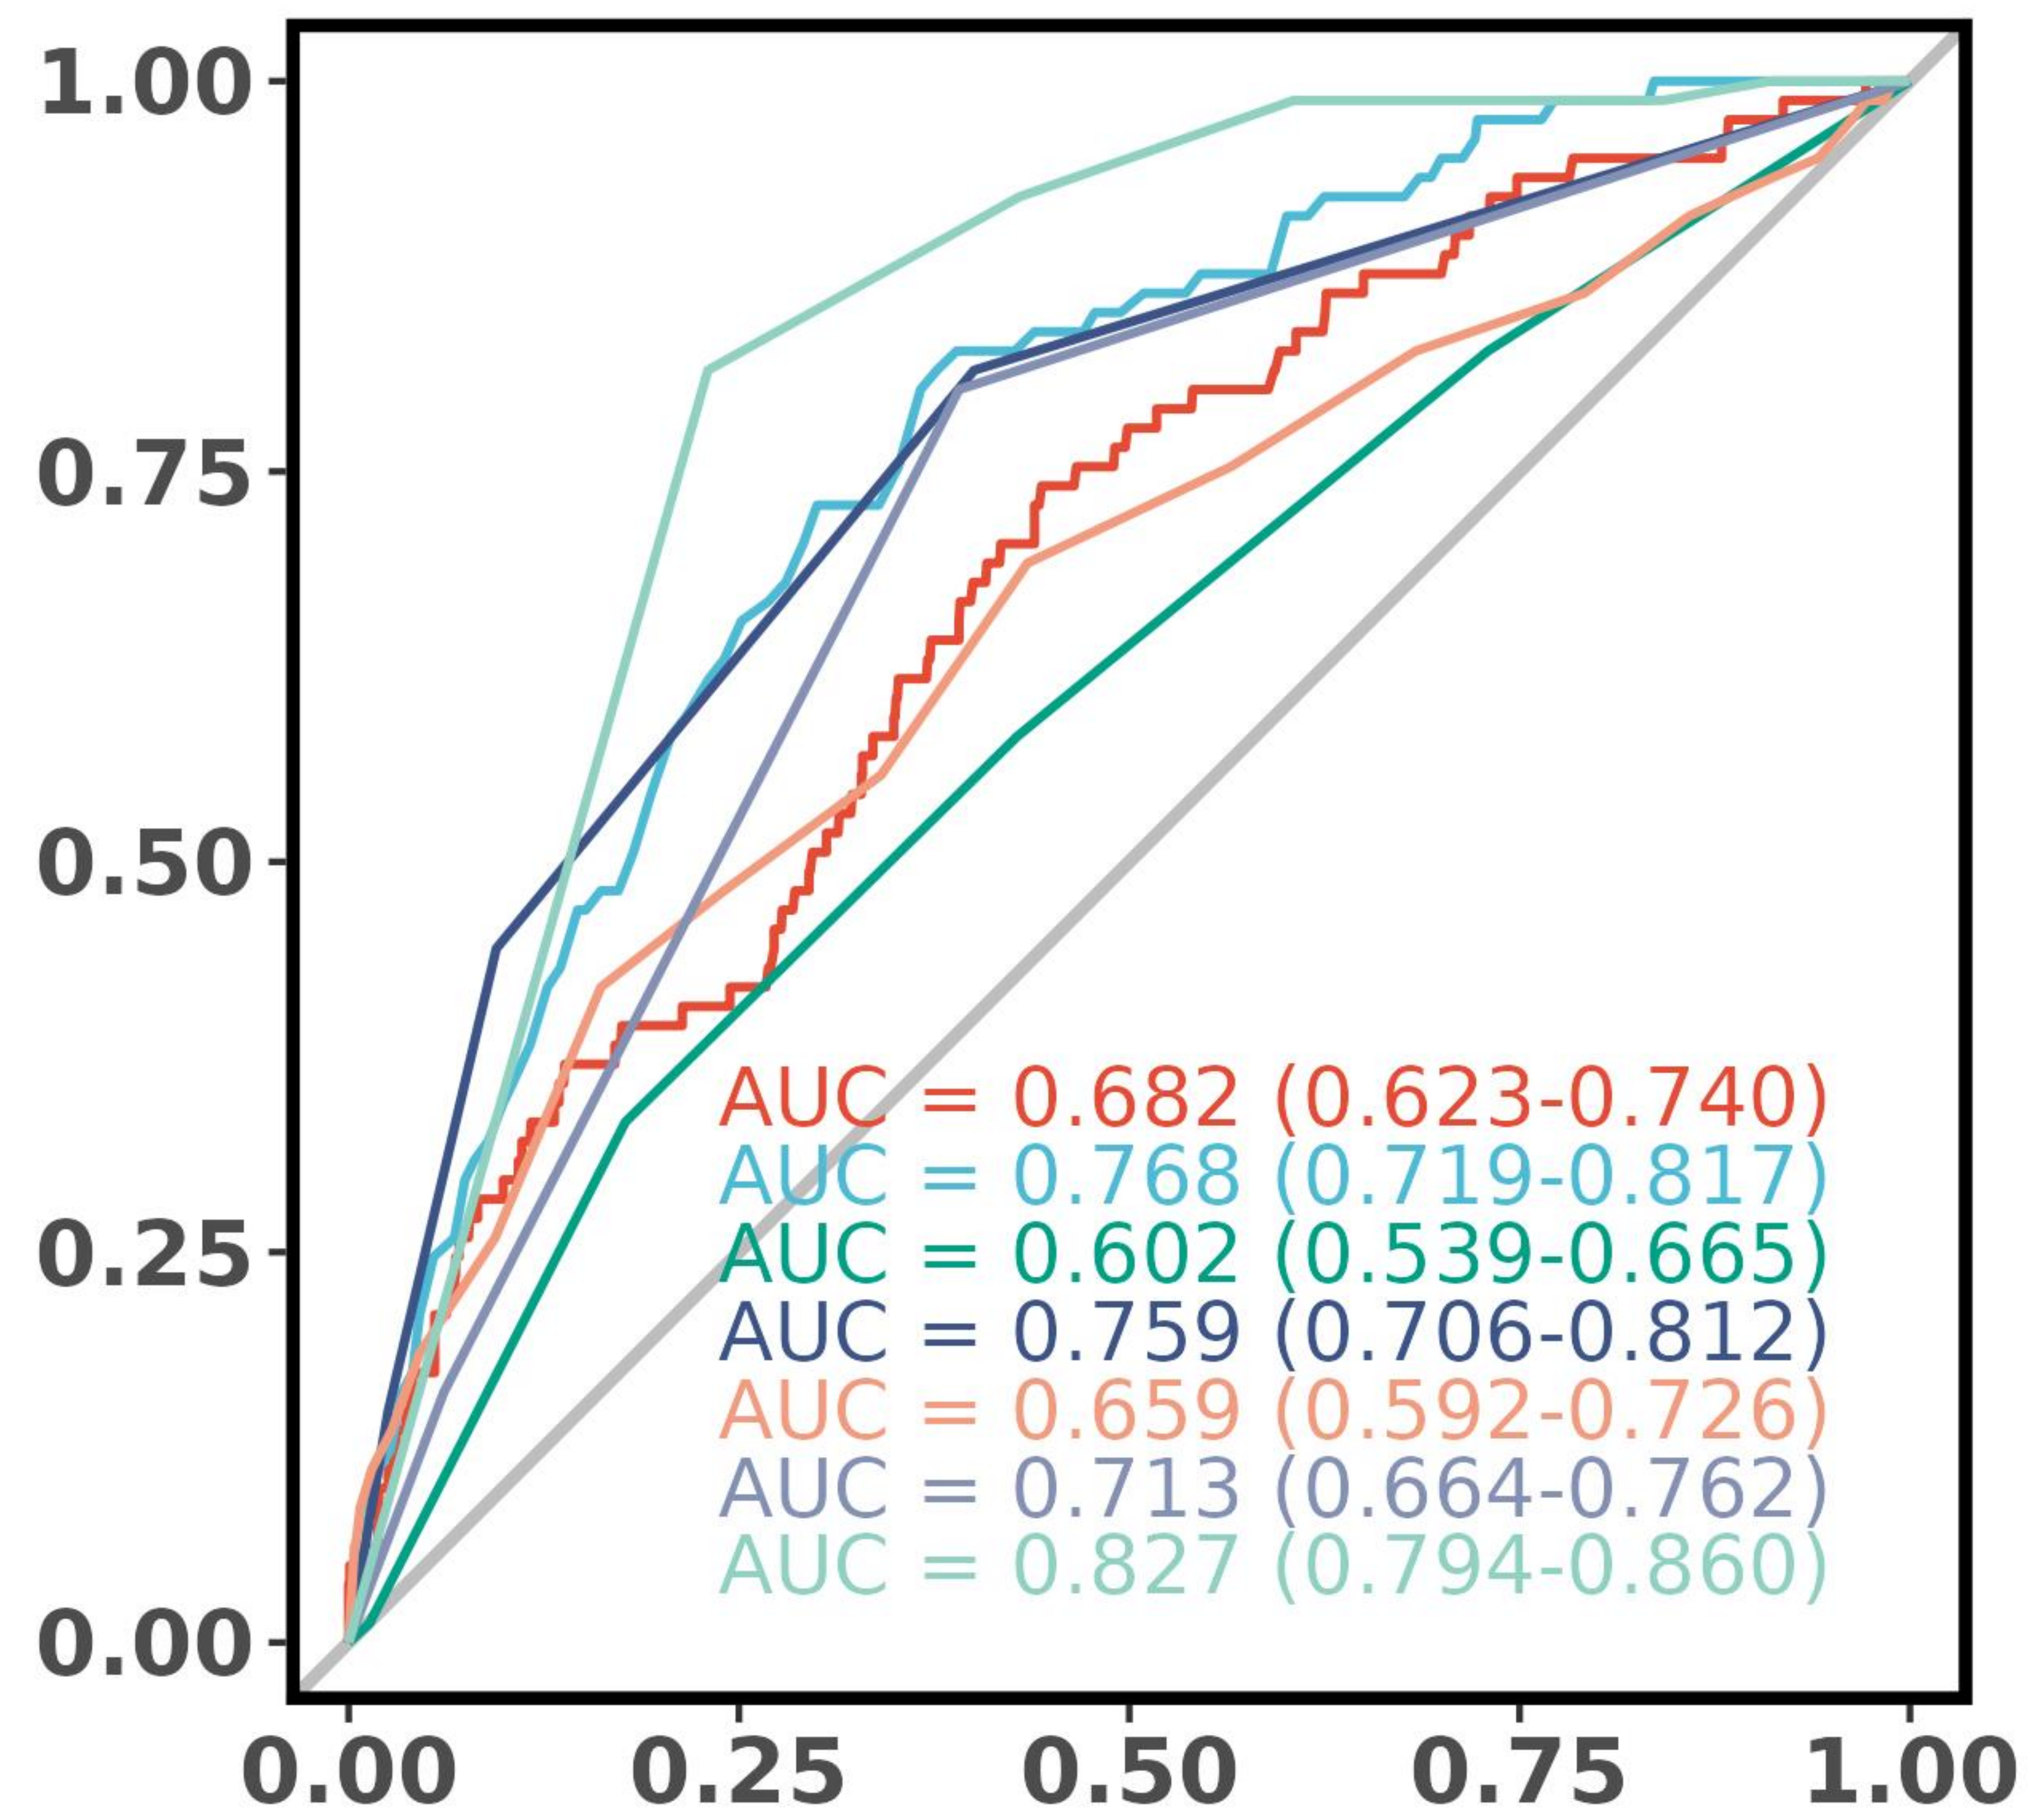

- Basal FSH
- AMH
- AFC
- COS protocol
- Duaration of stimulation
- $\Delta E2$
- No. of follicles ≥ 14 mm on trigger

False positive rate (1 - specificity)