Figure S1

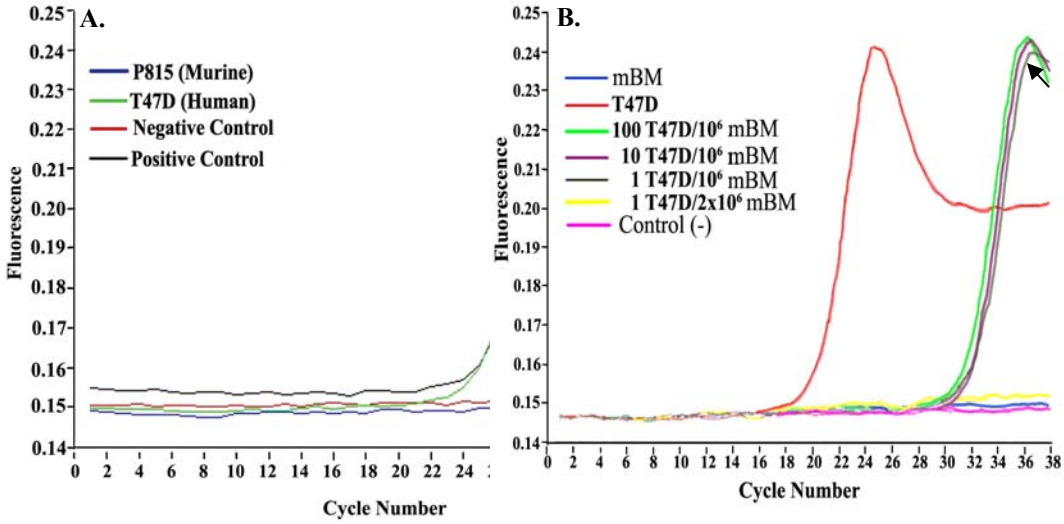
A.
P815 (Murine)
T47D (Human)
Negative Control
Positive Control
Fluorescence
Cycle Number
B.
mBM
T47D
100 T47D/10⁶ mBM
10 T47D/10⁶ mBM
1 T47D/10⁶ mBM
1 T47D/2x10⁶ mBM
Control (-)
Fluorescence
Cycle Number