


Supplemental Figure. Concordance of sonication and vortexing fluid cultures in prosthetic joint infection and aseptic failure.

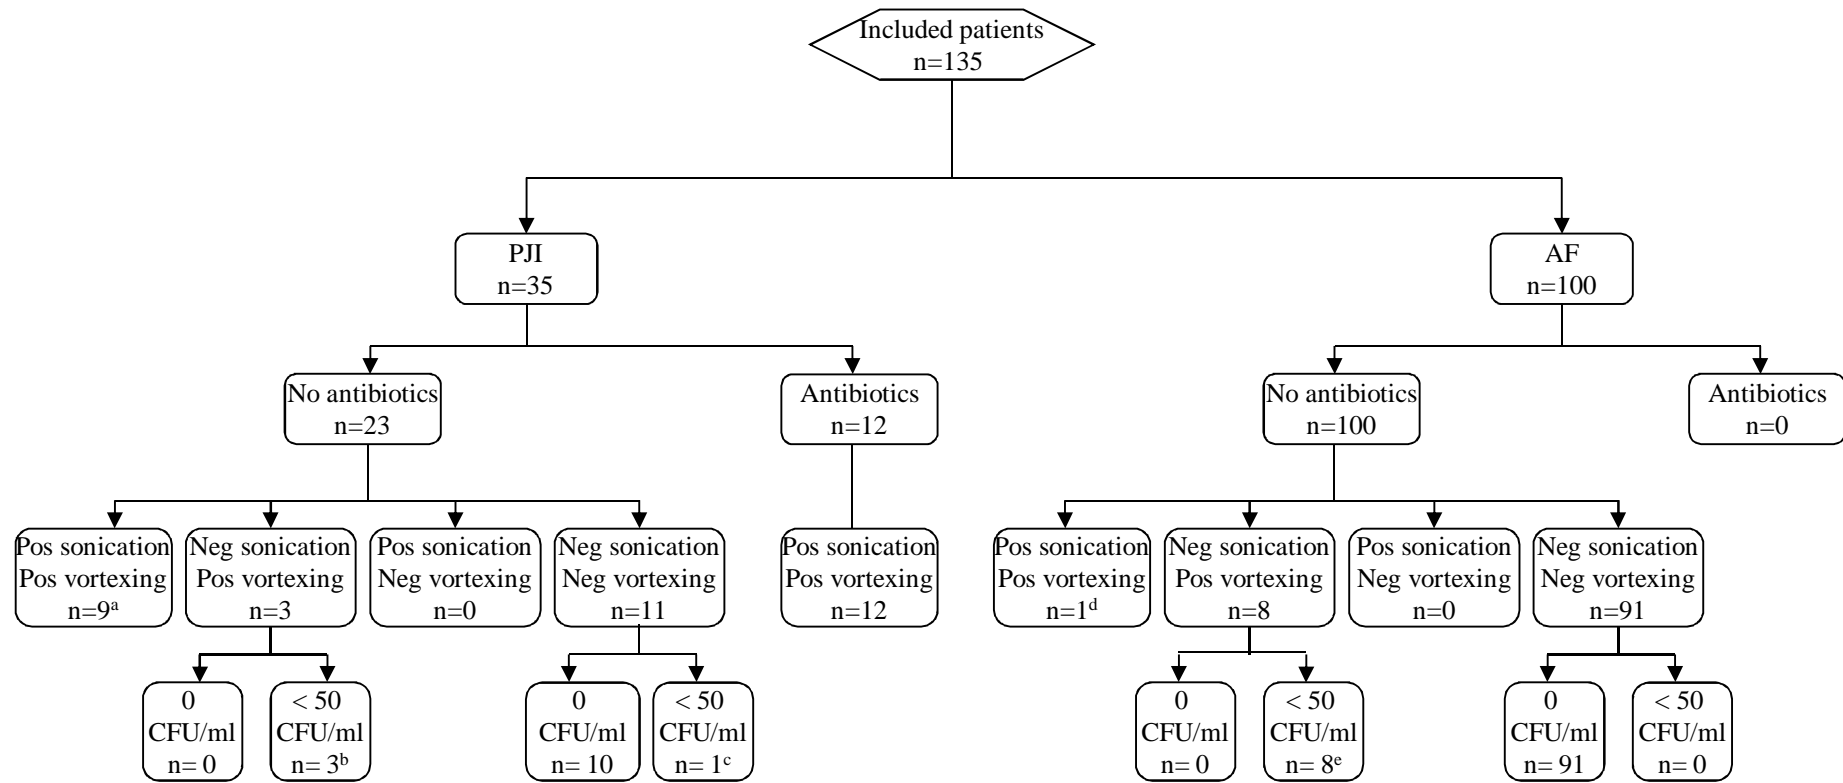

Note. PJI, prosthetic joint infection; AF, aseptic failure; Pos, positive; Neg, negative.

^aEight concordant cases and 1 discordant case (additional *P.mirabilis* detected by sonication fluid culture).

^bCoagulase-negative staphylococci (n=3).

^c*P.multocida* (n=1).

^d*Corynebacterium* sp. (n=1)

^e*Propionibacterium* sp. (n=7), coagulase-negative *staphylococcus* (n=1)