

Sampling Buffer: ~10 ml antimicrobial cocktail

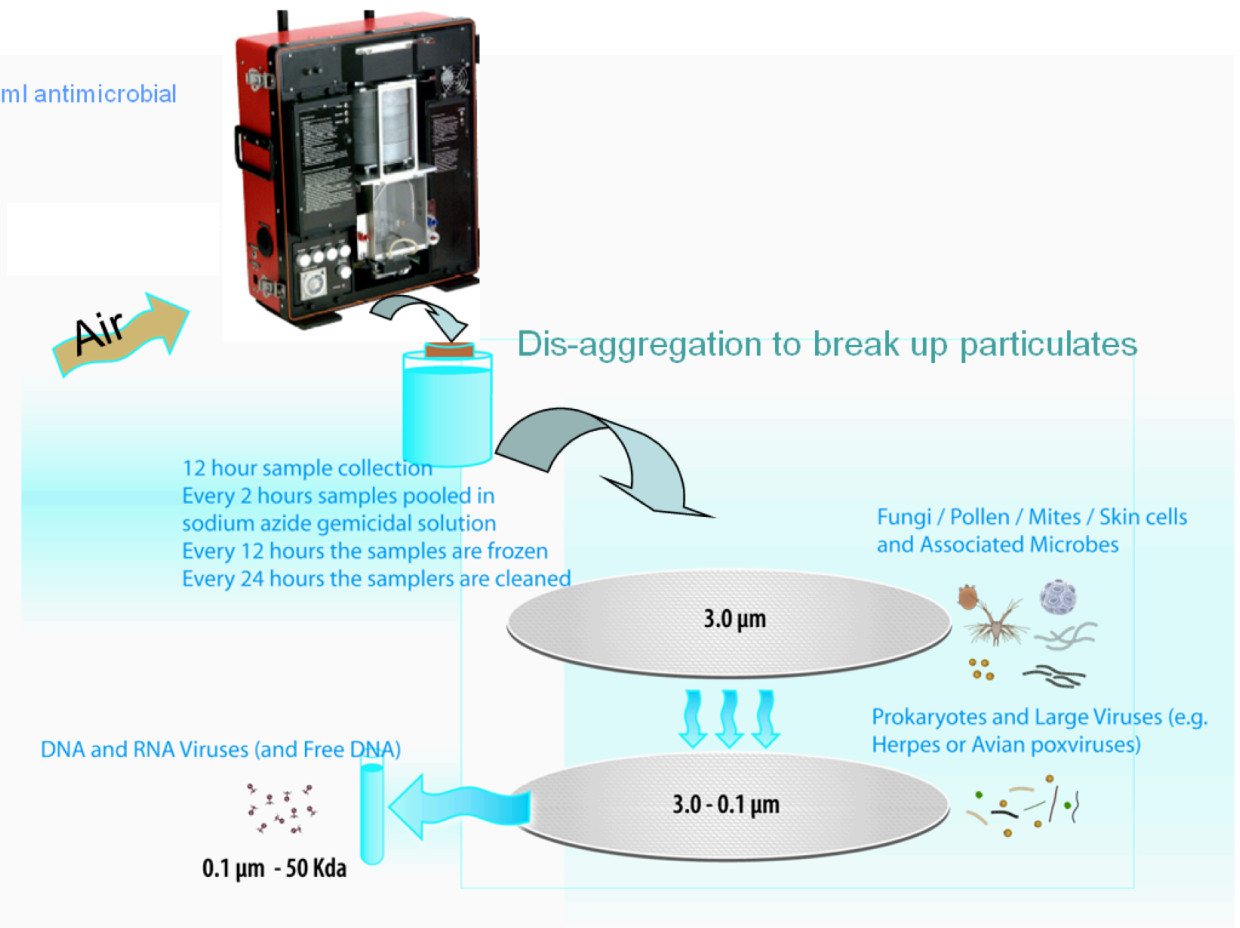


Figure S1: Sampling of airborne microorganisms.