



a) Magela Creek Water Control

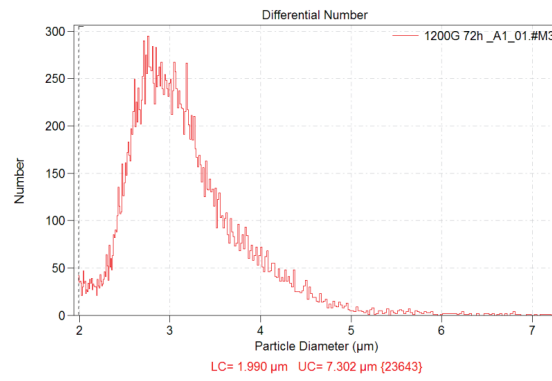

b) 100% Synthetic Seepage

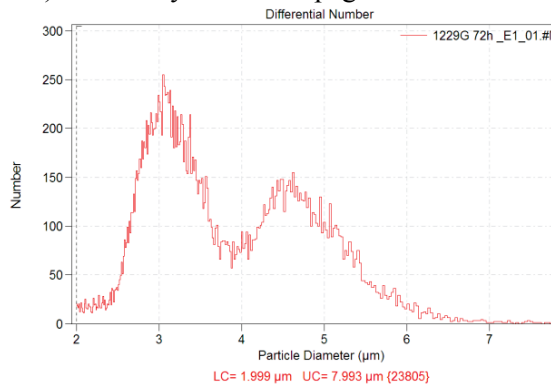

c) 100% Mine Seepage

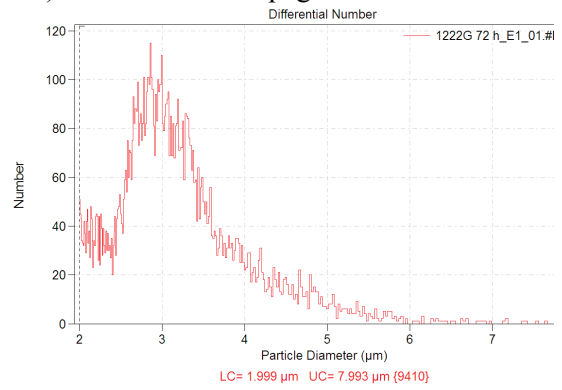


Figure S2 Examples of electronic particle counter histograms for *Chlorella* sp. exposed to a) Control b) Synthetic Seepage c) Mine Seepage for 72 hours.