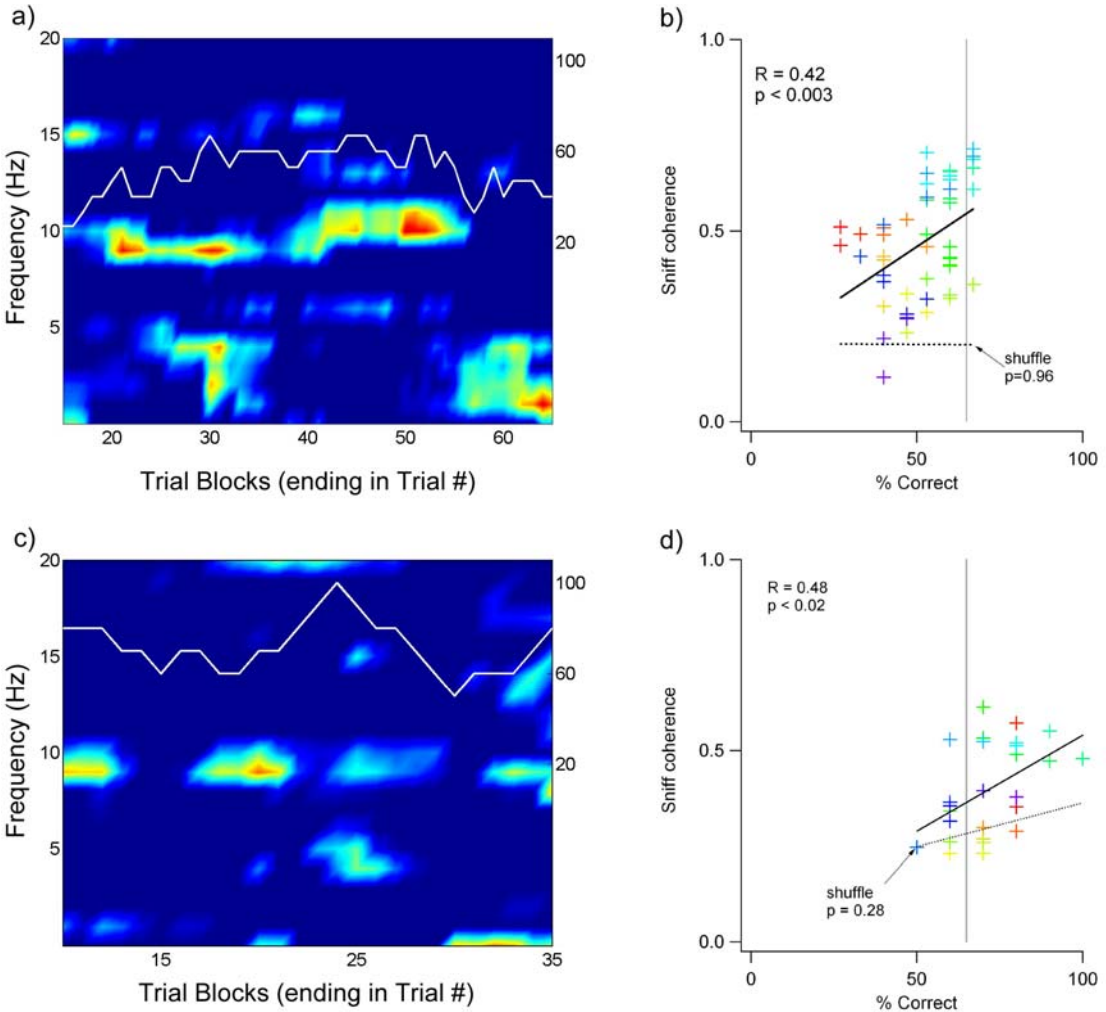
a)
Frequency (Hz)
Trial Blocks (ending in Trial #)
b)
R = 0.42
p < 0.003
Sniff coherence
shuffle
p=0.96
% Correct
c)
Frequency (Hz)
Trial Blocks (ending in Trial #)
d)
R = 0.48
p < 0.02
Sniff coherence
shuffle
p = 0.28
% Correct