

Supplementary Figure

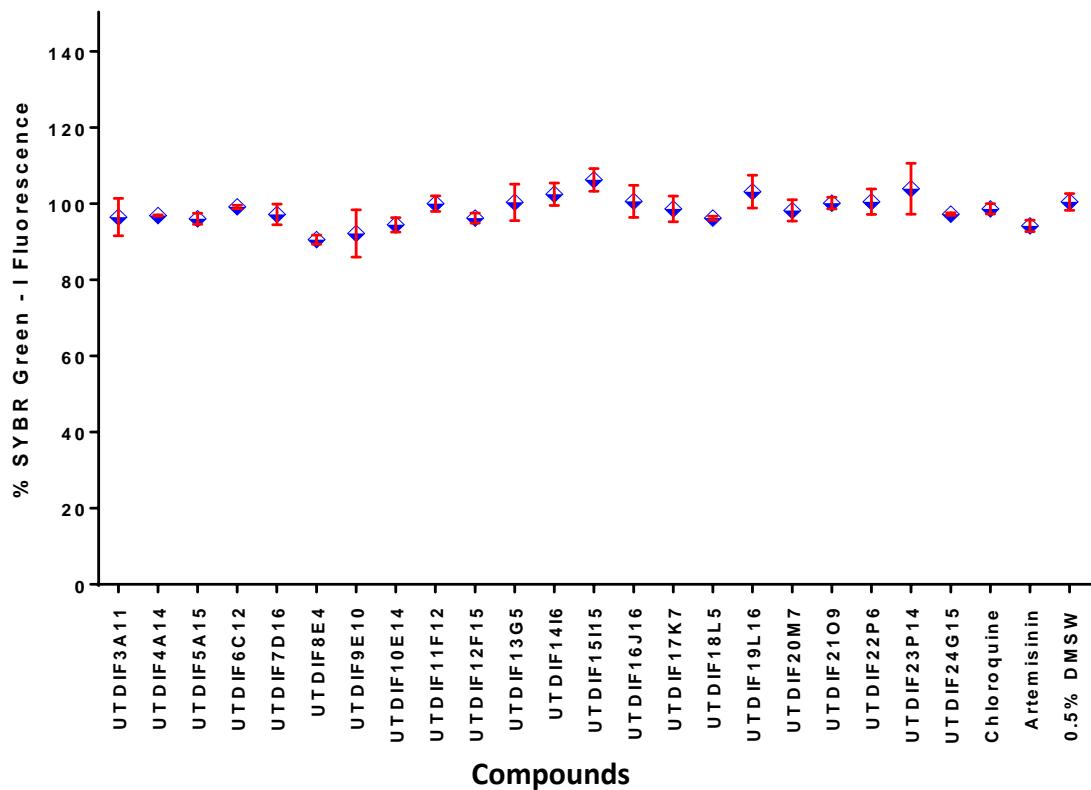


Figure S1. The percent of fluorescence of 22 compounds, Artemisinin and Chloroquine (positive control) and 0.5% DMSO (negative control) have shown. The percent of fluorescence of all compounds are compared with the percent of fluorescence of 0.5% DMSO (negative control).