


SUPPLEMENTAL FIGURE 1:

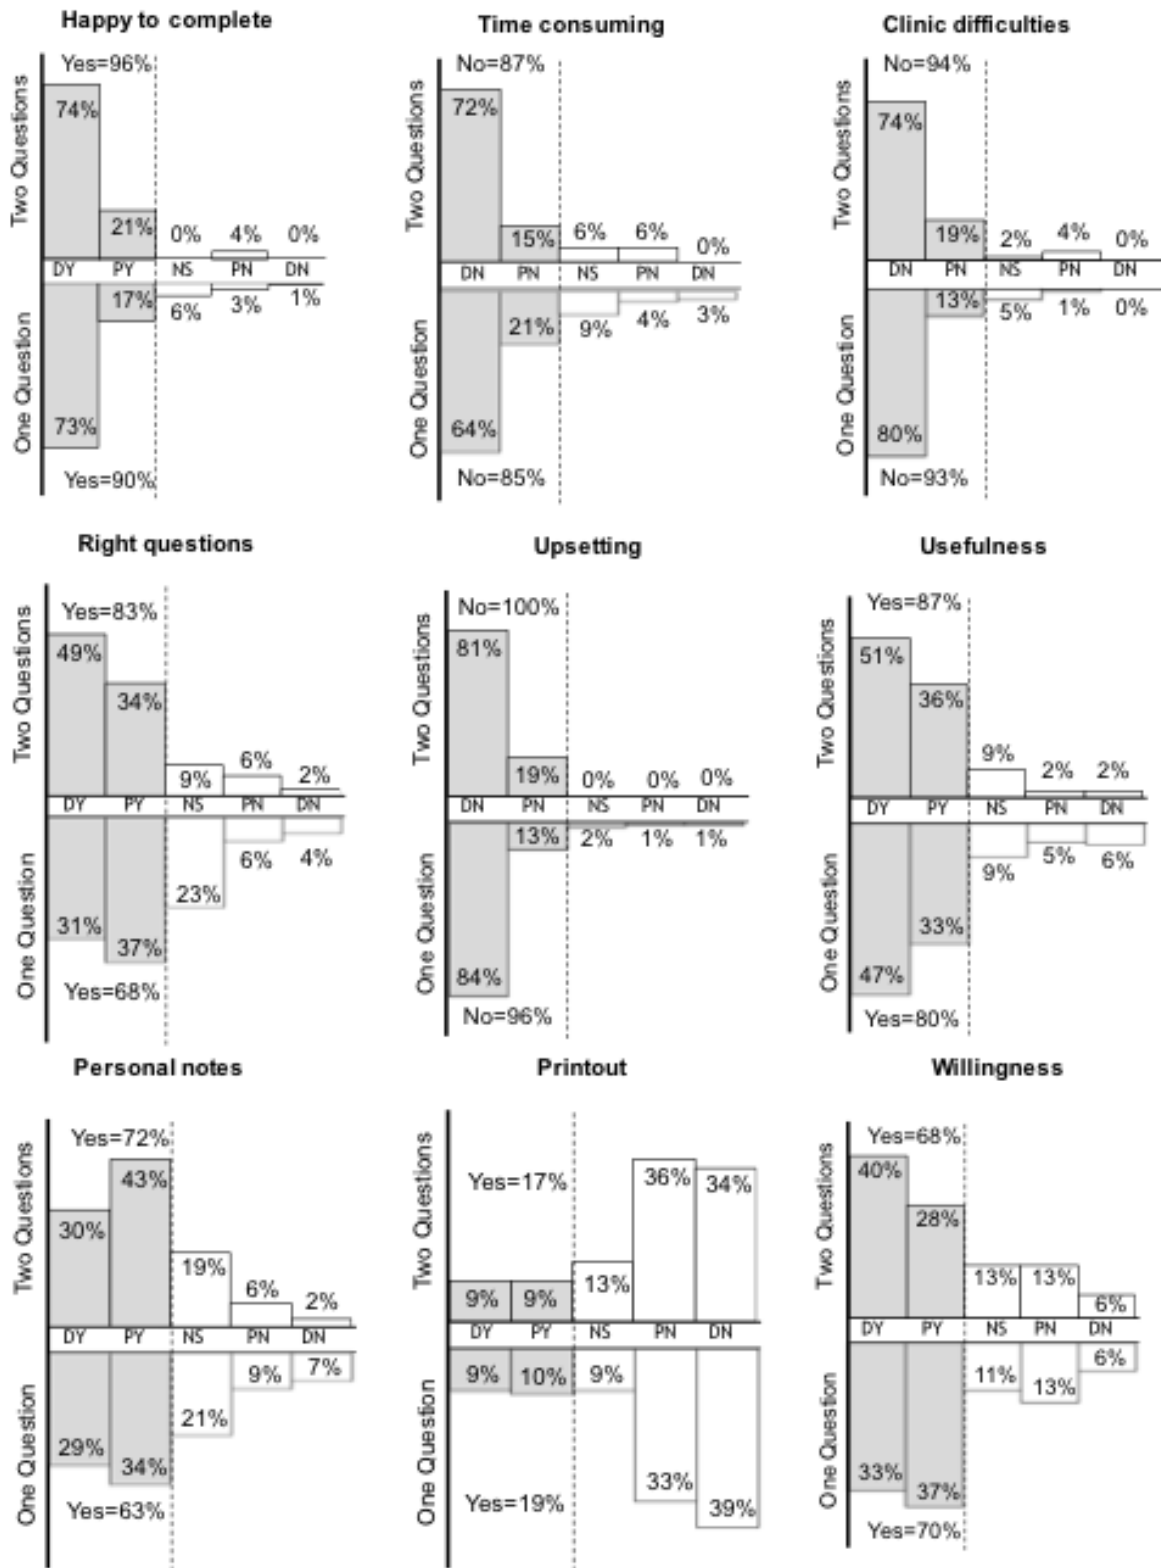

SUPPLEMENTAL FIGURE 1. Feasibility and acceptability responses for Phase 2 Screener.
DY=definitely yes, PY=probably yes, NS=not sure, PN=probably not, DN=definitely not.