


Supplement

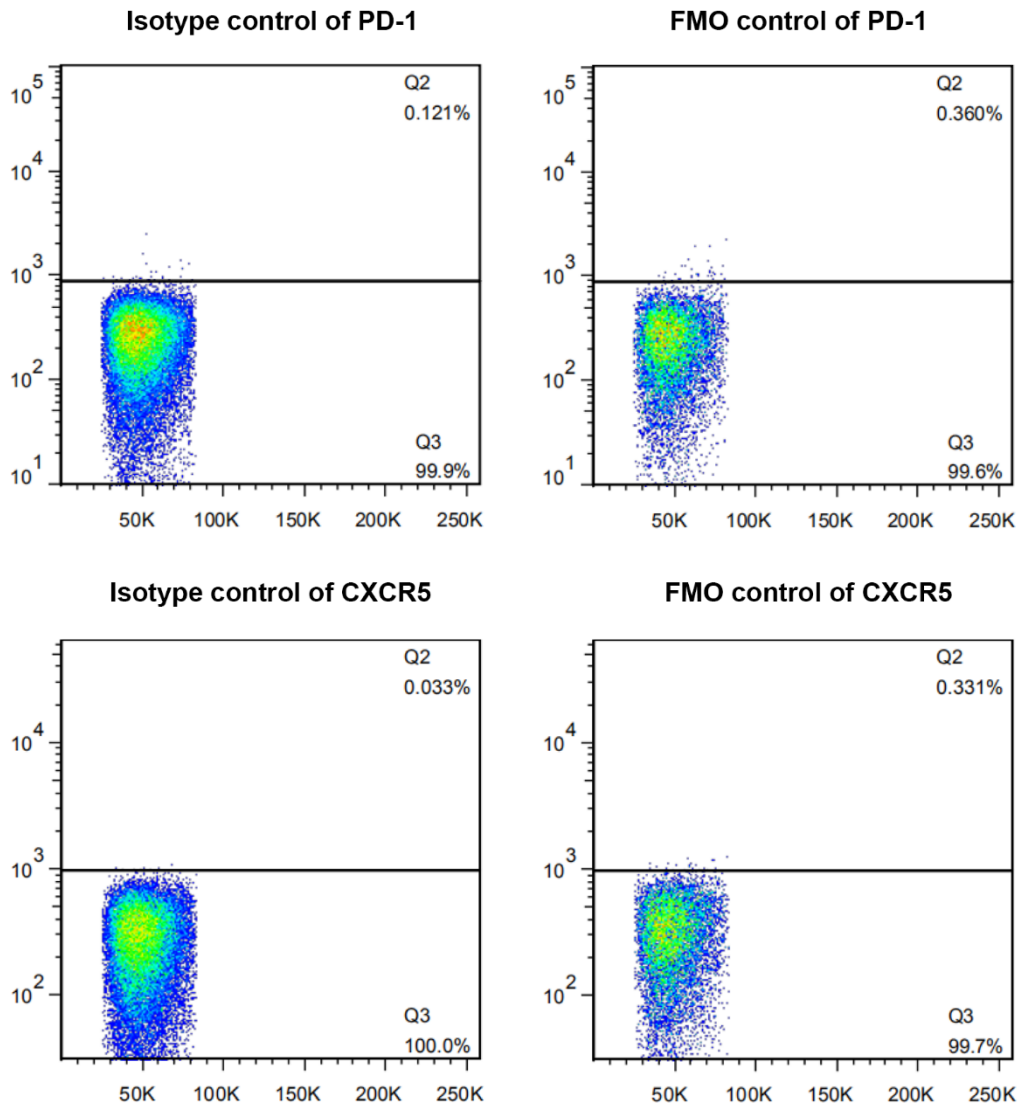

The FMO and isotype controls for PD1 and CXCR5. There was little fluorescence leakage in PD-1 channel or CXCR5 channel.