


A)

Primer	Sequence (5' to 3')
F3	CTTAGGATTGCCTACG
B3c	AGTCCAGTTACATTTTCT
FIP (F1c+F2)	AGTGTGCTGTTTCAGTAGTGATTCATCACAGGGTT
BIP (B1+B2c)	TGTAATGTCAACCGCTTTGCGACGTGGTATTTTC
LoopB	TCTTTATGACAAACTGCAAT
LoopFc	TTTGTGTGAATATGACATAGTCATA

B)

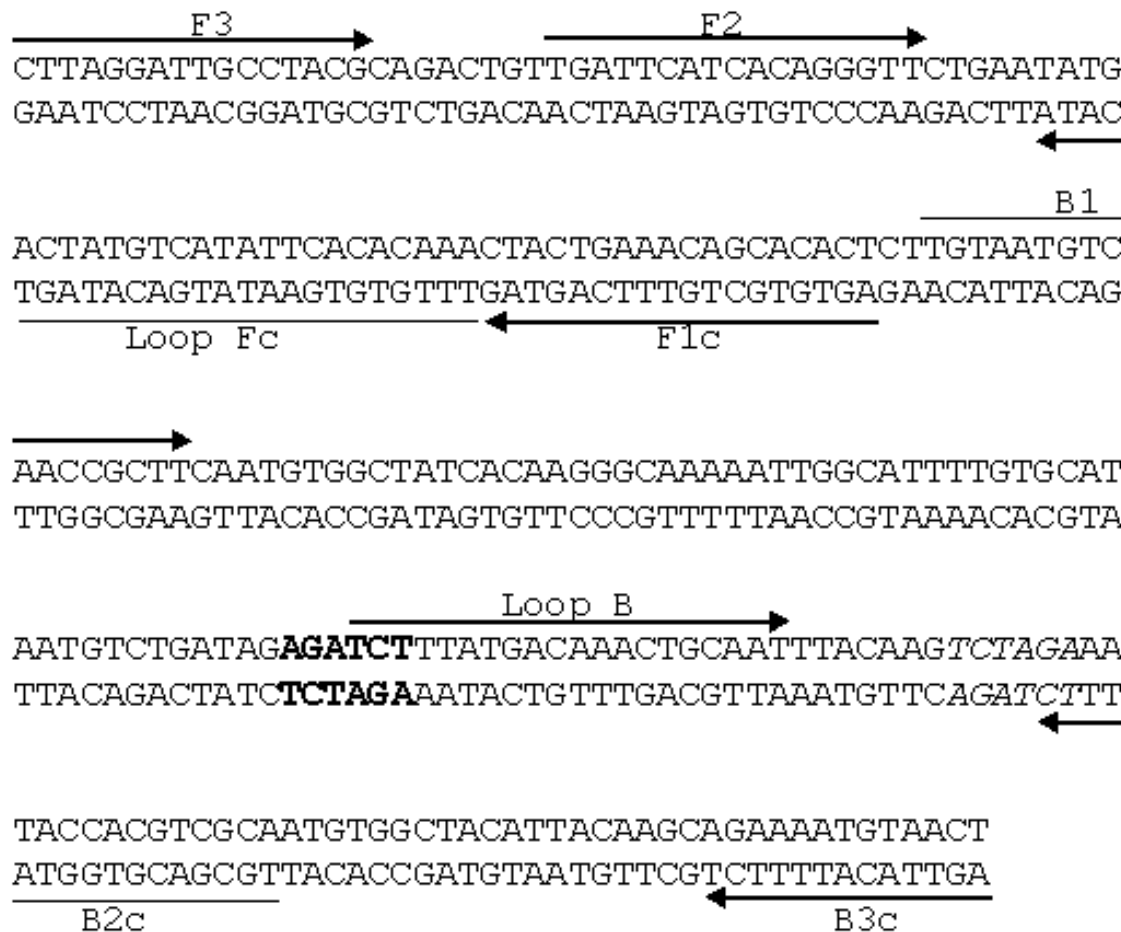

Supplementary Figure 1S. A) Primer sequences used in the LAMP assay. B) SARS-Cov viral sequence used in the assay. Corresponding recognition sequences of the primers are indicated by arrows. The Bgl II and Xba I restriction sites are bolded and italicized, respectively.