

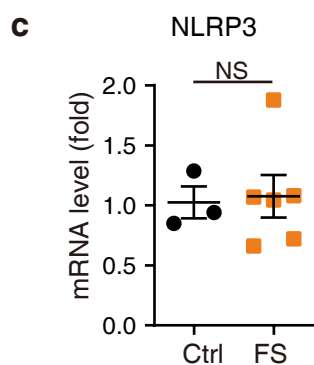
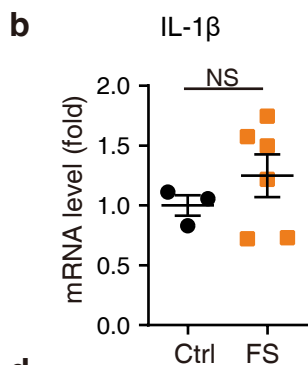
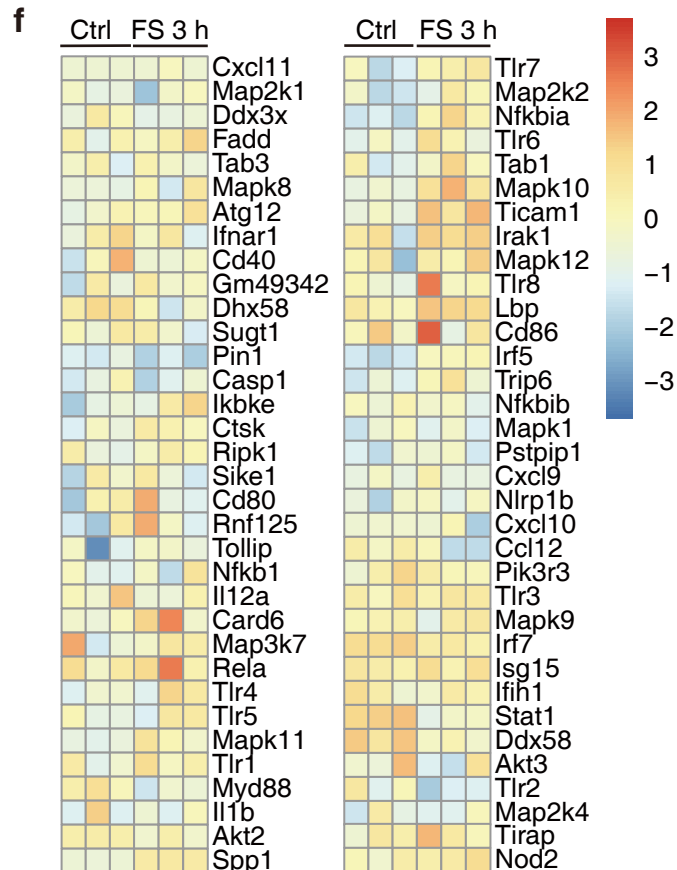



Figure S2

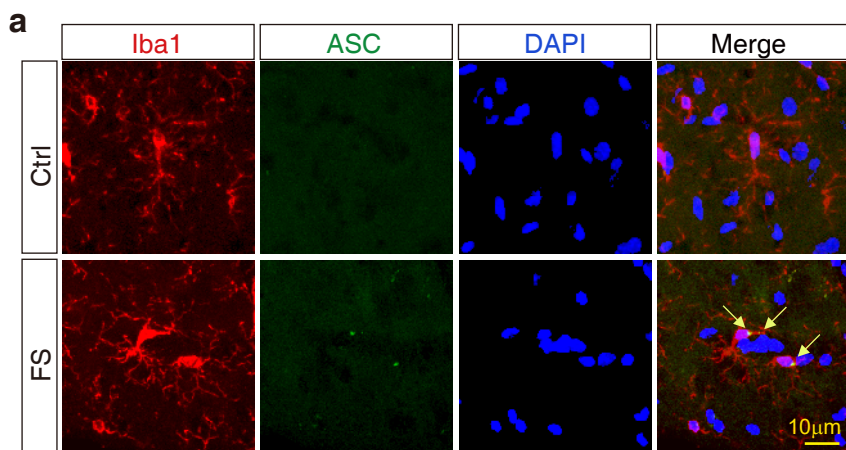


d FS 72 h vs Ctrl Up regulated

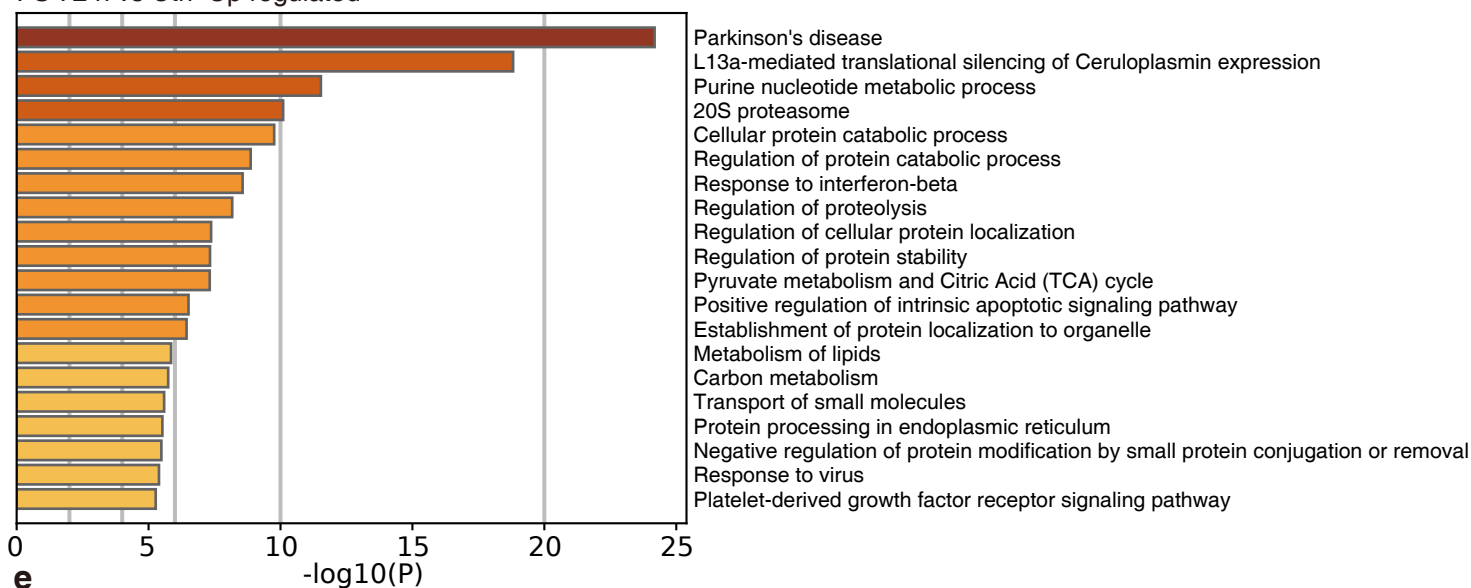


e FS 72 h vs Ctrl Down regulated

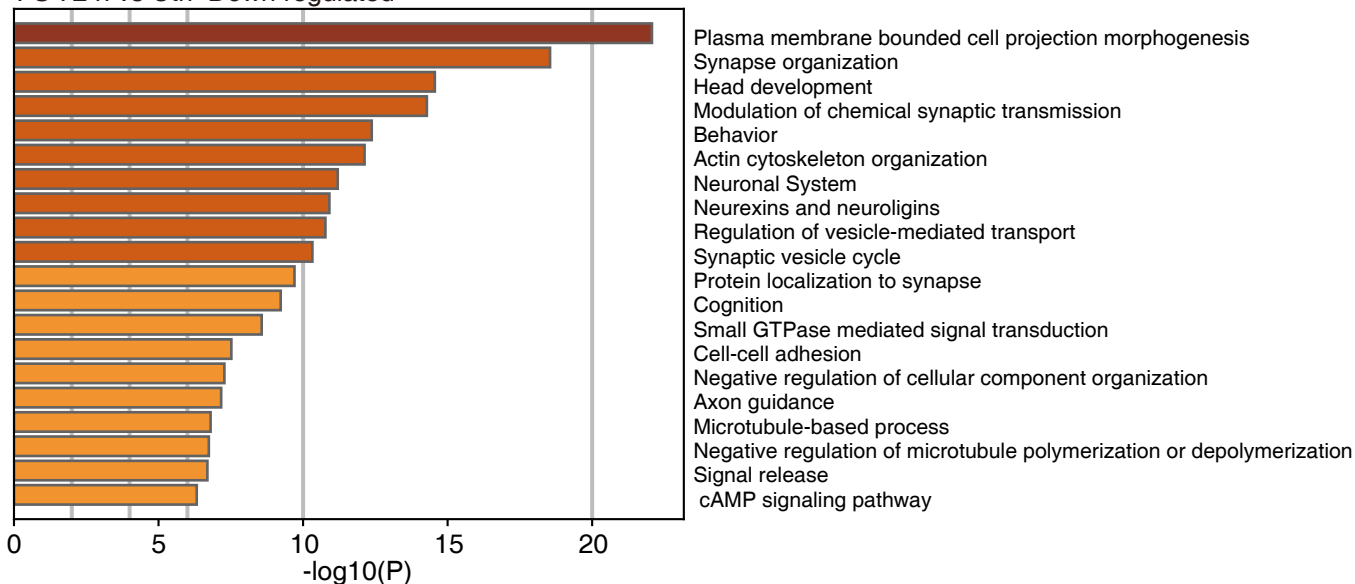

a *Nlrp3*^{-/-} vs WT 72 h Up regulated

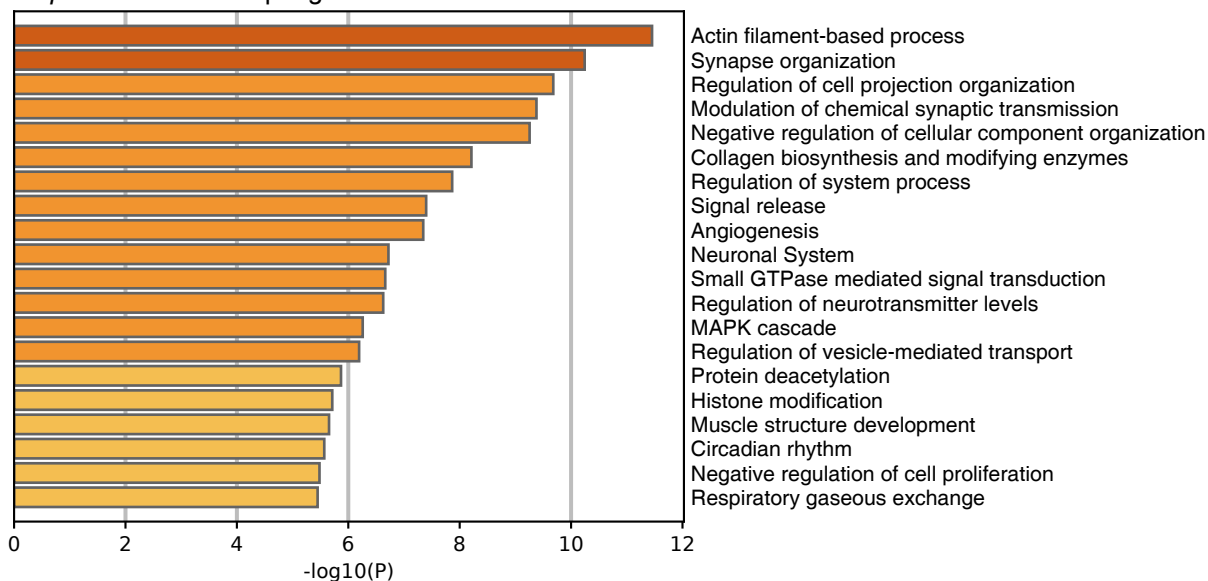

b *Nlrp3*^{-/-} vs WT 72 h Down regulated

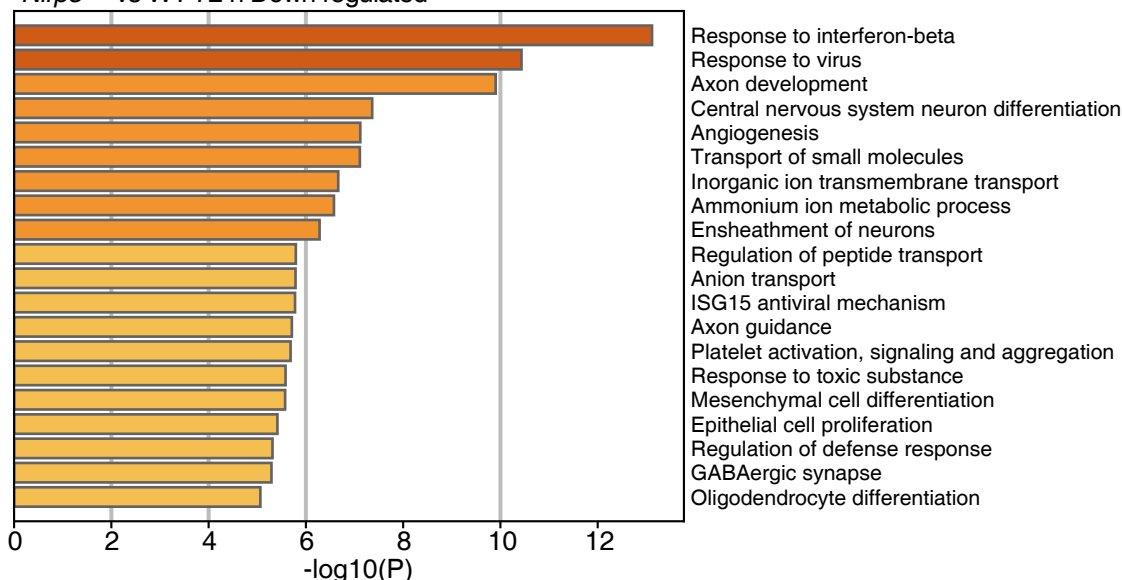

c FS 3 h
 WT *Nlrp3*^{-/-}

